



5 WTC PART PLAN B2 LEVEL
FUEL OIL TANK ROOM


PUMP SCHEDULE										BASIS OF DESIGN: PREFERRED UTILITIES	
PUMP NO.	LOCATION	GPM	TOTAL HEAD (FT.)	NPSH REQ'D (FT.)	OPERATING PRESS. (PSIG)	FLUID TEMP. (°F)	MOTOR DATA	RPM	PUMP TYPE	REMARKS	
FP-1	B2 LEVEL TRANSFER SET	1800	175	—	200	70°	5 460/3	1140	POSITIVE DISPLACEMENT	MODEL #	LO-208 DP
FP-2	B2 LEVEL TRANSFER SET	1800	175	—	200	70°	5 460/3	1140	POSITIVE DISPLACEMENT	MODEL #	LO-208 DP
FP-3	B2 LEVEL FUEL MAINTENANCE SET	1200	—	—	200	70°	1 1/2 460/3	1140	POSITIVE DISPLACEMENT	—	—
FP-4	B2 LEVEL FUEL MAINTENANCE SET	1200	—	—	200	70°	1 1/3 —	1140	—	—	—
FP-5	B2 LEVEL FUEL MAINTENANCE SET	1200	—	—	200	70°	1 1/3 —	1140	POSITIVE DISPLACEMENT METERING PUMP	—	—

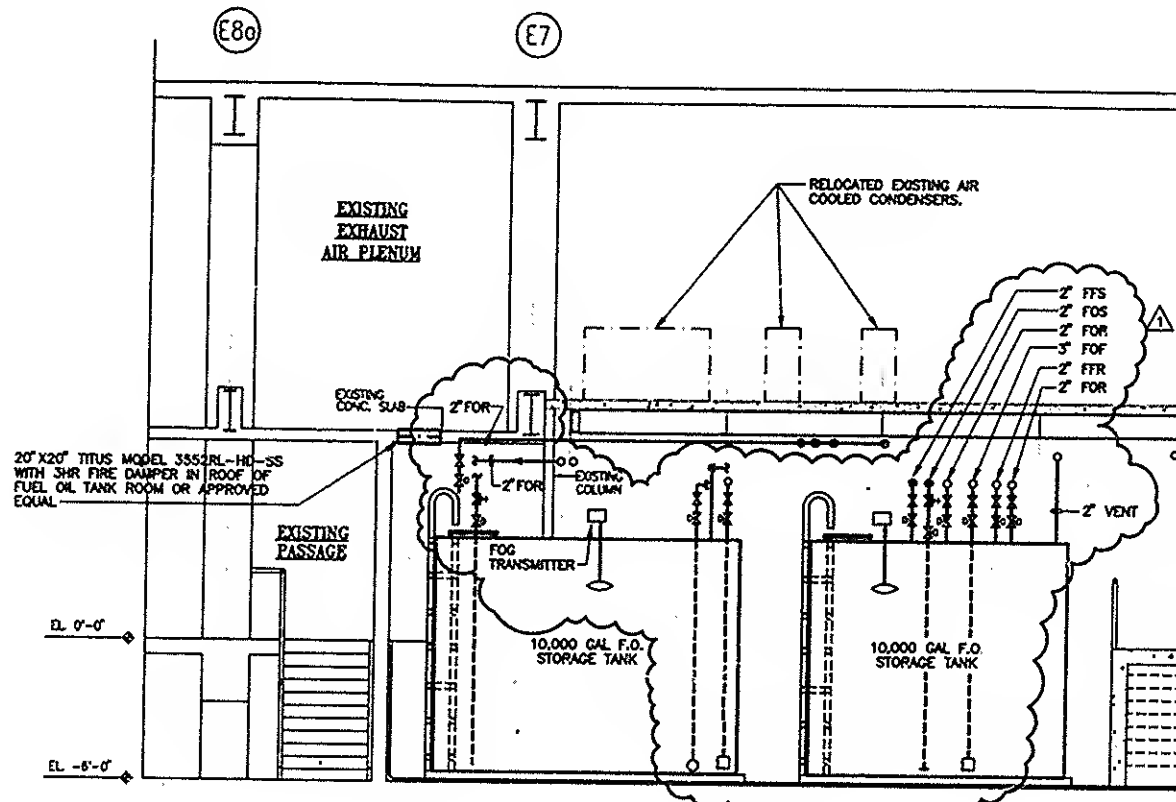

A SECTION

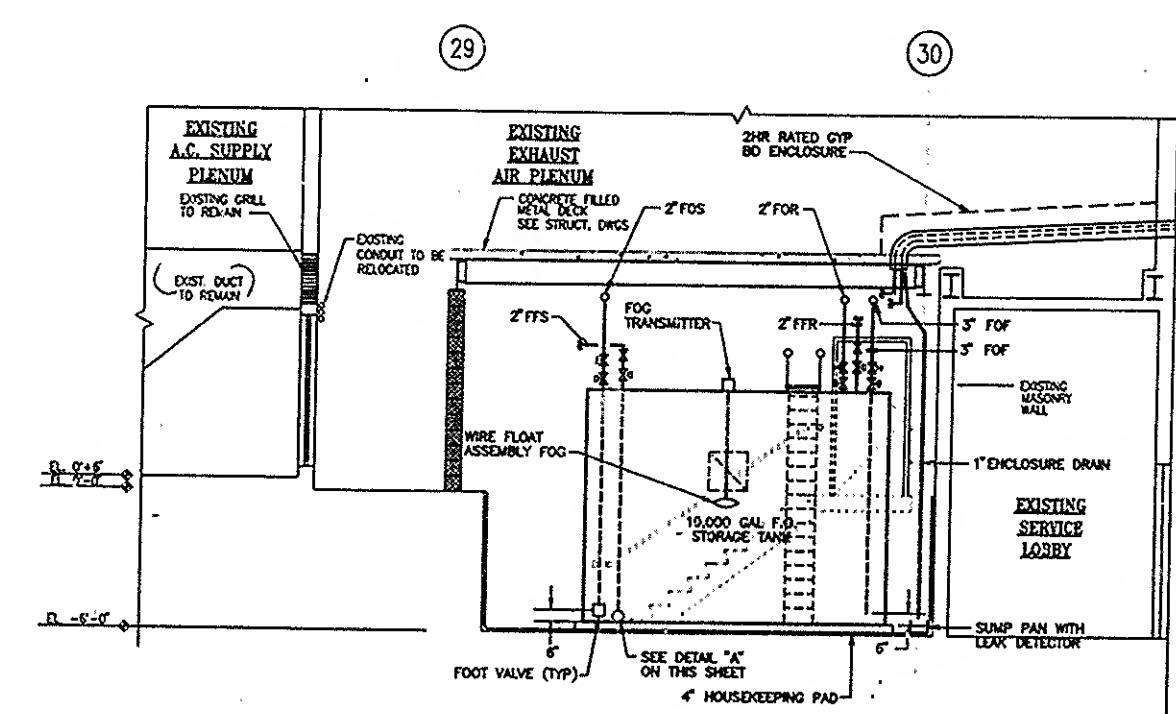

B SECTION

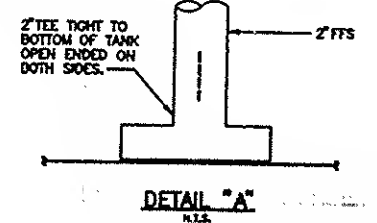

DETAIL "A"

NOTE:
1. 10,000 GAL. FUEL OIL TANKS TO BE 12'-6" LONG x 11'-6" WIDE x 10'-0" DEEP.